

This section provides an overview and general design guidelines for nVent RAYCHEM tank heating systems using electric heat tracing cables and tank heating pads. For complete design assistance, contact your nVent representative or visit our website at nVent.com/RAYCHEM.

Table of Contents

INTRODUCTION	1
Self-Regulating Heating Cables	2
Power-Limiting Heating Cables	2
Mineral Insulated (MI) Series Resistance Heating Cables	3
TANK TRACING DESIGN AND PRODUCT SELECTION	4
Overview	4
Self-Regulating Heating Cables	6
Power-Limiting Heating Cables	6
Mineral Insulated Heating Cables	6
TANK HEAT LOSS CALCULATION.....	13

INTRODUCTION

nVent provides a wide selection of heat-tracing solutions for tanks and vessels. Typical applications for electrical heat tracing of tanks and vessels include:

- Freeze protection of low and medium viscosity fluids (e.g., water, ammonia)
- Temperature maintenance for medium viscosity fluids (e.g., oils, resins)
- Crystallization prevention (e.g., caustic soda)
- Condensation prevention (e.g., fly ash in conical bases of silos)

Contact nVent for heat-up applications, hazardous locations, heat tracing of high viscosity fluids (e.g. heavy oils), applications where agitation is used, and other nonstandard applications.

Tank heating applications can be quite varied. For this reason, nVent offers a wide range of technologies to optimize your tank and vessel heat-tracing system.

- Self-regulating heating cables
- Power-limiting heating cables
- Mineral insulated series resistance heating cables

A description of the features and benefits of each technology is provided, followed by the design and product selection steps.

Self-Regulating Heating Cables

nVent RAYCHEM brand self-regulating heating cables (BTV, QTVR, XTVR and HTV) are ideal for tank heating when design and installation flexibility are required. The benefits include:

Forgiving technology For over 40 years, these self-regulating heating cables have proven their reliability and remain the premier self-regulating heating cables in the market.

Easy installation Because of parallel circuitry and flat cable design, our self-regulating heating cables are easy to handle and install. They can be cut to any length on site and overlapped without the risk of overheating. The cables readily accommodate design adjustments between specifications and actual on-site installation needs.

Uniform temperatures Heat is evenly distributed over the heat-traced surface. The self-regulating feature of the heating cable responds to actual conditions of the traced surface. Temperature control is simplified, especially for tanks with fill-height variation.

T-ratings Self-regulating heating cables have a T-rating per national electrical codes.

Approvals These self-regulating systems are approved and certified for use in nonhazardous and hazardous locations.

These self-regulating heating cables can be used for maintain temperatures up to 400°F (205°C). Technical information is provided in the data sheets in the Technical Data section of this catalog.

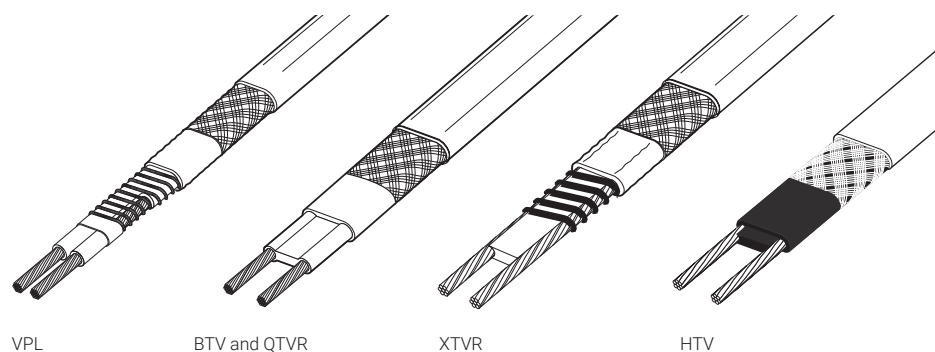


Fig. 1 Self-regulating heating cables

Power-Limiting Heating Cables

nVent RAYCHEM brand power-limiting heating cables (VPL) feature high power output at high maintain temperatures. These flexible heating cables are rated for maintain temperatures up to 455°F (235°C) and exposure temperatures (power off) to 500°F (260°C). Power-limiting heating cables feature:

Superior temperature capability in a flexible heater These cables are especially suited to applications requiring high power output at elevated temperatures and requiring field installation flexibility to accommodate small tank structure or design modifications.

Easy installation Cables can be cut to length and terminated in the field.

Uniform distribution of heat Heat is evenly and widely distributed over the heat-traced surface.

Approvals nVent RAYCHEM power-limiting systems are approved and certified for use in nonhazardous and hazardous locations.

Mineral Insulated (MI) Series Resistance Heating Cables

Mineral insulated heating cables offer a wide variety of solutions for industrial heat-tracing applications. MI heating cables are series-type heating cables and suitable for maintain temperatures up to 1022°F (550°C) and exposure temperatures up to 1200°F (650°C). MI heating cable is the ideal choice when an application's temperature and power output requirements exceed the capabilities of self-regulating and power-limiting heating cables.

MI heating cables can be used for applications with the following requirements:

- Maintain temperature up to 1022°F (550°C)
- Power output to 61 W/ft (200 W/m)
- Maximum heating cable exposure temperature to 1200°F (650°C)

Higher temperature and power capabilities are available; contact nVent for additional information.

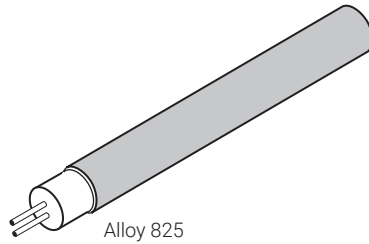


Fig. 2 MI heating cables

Additional technical information can be found in the data sheet in the Technical Data section. Data sheets can be found on nVent.com/RAYCHEM or the Technical data sheet section of the Industrial Heat Tracing Products & Services Catalog (H56550). Refer to the Section 3, Mineral Insulated Cables, design guide (H56884) for more detailed information.

Overview

Follow the five steps below to select the heating products and create a bill of materials for your tank application. If your tank application requires heat-up or condensation prevention, contact nVent for assistance.

- 1. Gather the necessary application data.
 - Tank type
 - Tank diameter
 - Tank height
 - Tank support
 - Tank insulation type and thickness
 - Maintain temperature
 - Tank contents
- 2. Calculate the tank heat loss.
- 3. Choose the heating technology.
- 4. Product selection.
- 5. Select the thermostatic control.

Tank Tracing
1. Gather information
2. Calculate tank heat loss
3. Choose heating technology
4. Product selection
5. Select thermostatic control

Step 1. Gather the necessary data

Gather and record the following information. Alternatively, use the design worksheet in Appendix B to record your application data. You will use this information for the steps that follow.

- Tank type_____
- Tank diameter _____
- Tank height_____
- Tank support _____
- Tank insulation type and thickness_____
- Maintain temperature_____
- Tank contents _____

Example: Information on three sample applications

Tank type (all)	Vertical cylinder
Tank diameter (all)	3 ft
Tank height (all)	6 ft
Tank support (all)	4 legs
Tank insulation type and thickness (all)	Fiberglass insulation, 2-in
Tank 1 Maintain temperature	100°F at 0°F ambient
Contents	polyol
Tank 2 Maintain temperature	40°F at 0°F ambient
Contents	water
Tank 3 Maintain temperature	400°F at 0°F ambient
Contents	bitumen

Tank Tracing
1. Gather information
2. Calculate tank heat loss
3. Choose heating technology
4. Product selection
5. Select thermostatic control

Step 2. Calculate the tank heat loss

The tank's thermal heat loss determines the power needed to maintain the tank at the desired temperature. To determine the heat loss, see "Tank Heat Loss Calculation" section, for formulas and tables. Using these resources, the heat loss of the example tanks was found to be:

Example: Results of tank heat loss calculations

Tank 1: $Q_{\text{total}} = 458 \text{ W}$ (from Tank Heat Loss calculation)

Tank 2: $Q_{\text{total}} = 178 \text{ W}$ (from Tank Heat Loss calculation)

Tank 3: $Q_{\text{total}} = 2070 \text{ W}$ (from Tank Heat Loss calculation)

Tank Tracing
1. Gather information
2. Calculate tank heat loss
3. Choose heating technology
4. Product selection
5. Select thermostatic control

Step 3. Choose the heating technology

nVent offers a range of tank heating solutions.

Table 1 provides a rough guide for the selection of technologies for different applications. The continuing discussion that follows will help you understand and select the appropriate technology when more than one product choice is available or when an application does not easily fit those defined in the table.

Your choice of heating method depends on factors such as:

- Required maintain and exposure temperatures
- Material of the tank wall (metal or plastic)
- Temperature sensitivity and viscosity of the tank contents
- Whether or not the tank is agitated
- Additional requirements such as heat-up or prevention of condensation

TABLE 1 PRODUCT SELECTION GRID

Application or requirement	Self-regulating		Power-limiting VPL	Mineral insulated MI
	BTV	QTVR, XTVR, HTV		
Flexible field design required	•	•	•	
Plastic tank wall	•	(QTV only)		
Plastic-lined tank wall	•	(QTV only)		
Even heat to all walls needed	•	•	•	
Maintain temperature more than 120°F (49°C)	•	•	•	•
Maintain temperature more than 200°F (93°C)		•	•	•
Maintain temperature more than 400°F (205°C)			•	•
Low installed cost desired				
High watt density needed		•	•	•
Distributed high watt density needed			•	•
Temperature-sensitive fluids	•	•		
Condensation prevention	•	•	•	•
Small-diameter stagnant tanks	•	•		
Limited tank surface area available			•	•
High heat-loss tanks			•	•

Self-Regulating Heating Cables

Uses

- Tanks containing temperature-sensitive fluids
- Tank materials such as PVC or PE
- Applications requiring uniform heating (condensation prevention)
- Tanks with unusual shapes to trace

Advantages

- Very flexible design and installation
 - Cables can be installed on any type of tank surface
 - Cables adapt to any shape or surface
 - Cables allow tracing with more power on high heat loss areas — just reduce the spacing between the heating cables in those areas
 - Cables can be cut to length in the field
- Even heat distribution due to larger heated surface
- Very smooth heating for tank walls with a low withstand temperature

Power-Limiting Heating Cables

Uses

- Tanks containing fluids that are less temperature sensitive
- Tanks with high heat loss, and where flexibility in installation is a premium
- Tanks with a maintain temperature between 300°F (150°C) and 300°F (150°C)

Advantages

- Very flexible design and installation
 - Cables can be installed on any type of tank surface
 - Cables adapt to any shape or surface
 - Cables allow tracing with more power on high heat loss areas — just reduce the spacing between the heating cables in those areas
 - Cables can be cut to length in the field
- Even heat distribution due to larger heated surface
- Very smooth heating for tank walls with a low withstand temperature

Mineral Insulated Heating Cables

Uses

- Maintain temperatures above 300°F (150°C)
- Exposure temperatures above 500°F (260°C)
- Tanks with high heat loss or high power requirements at elevated temperatures

Advantages

- Flexible design and installation
 - Cables can be installed on any type of tank surface
 - Cables can adapt to any shape or surface
 - Cables allow tracing with more power on high heat-loss areas — just reduce the spacing between the heating cables in those areas
- Even heat distribution due to larger heated surface
- Capability for high power output and density

Tank Tracing
1. Gather information
2. Calculate tank heat loss
3. Choose heating technology
4. Product selection
5. Select thermostatic control

Step 4. Product selection

When you have determined the most appropriate heating technology for your application, proceed to:

Step4a Product selection for self-regulating and power-limiting heating cables

Step4b Product selection for mineral insulated heating cables

Example:

Tank 1: We recommend the use of self-regulating heating cables.

Tank 2: We recommend the use of MI mineral insulated heating cables.

Step 4a Product selection for self-regulating and power-limiting heating cables

Overview

- Orientation of tank
- Spacing and arrangement of the heating cables
- Traced surface
 - Vertical cylindrical tanks
 - Horizontal cylindrical tanks
 - Conical outlets
- Thermal design for heating cables
 - Determine heating cable compatible with your tank application
 - Select heating cable with the lowest maximum exposure temperature
 - Adjust for aluminum tape attachment
 - Determine minimum required length of heating cable
 - Determine cable distribution
- Electrical design of heating cable
 - Determine maximum allowable circuit length of heating cable
 - Adjust for aluminum tape attachment
 - Ground-fault protection
- Heating cable component selection

The heating cable you select and the length of cable you will need depend on the orientation of the tank and the spacing and arrangement of the heating cables.




Fig. 3 Heating cable arrangement on a vertical tank




Fig. 4 Heating cable arrangement on a horizontal tank




Fig. 5 Heating cable arrangement on a truncated cone

DETERMINATION OF THE TRACED SURFACE

Vertical cylindrical tanks

Vertical cylindrical tanks are traced on the lower one-third of the side wall (maximum half) and the bottom (if accessible).

Horizontal cylindrical tanks

Horizontal cylindrical tanks are traced on a third of the bottom (maximum half).

Conical outlets

Conical outlets of vessels are often traced to prevent condensation inside. We recommend that the entire surface of the conical outlet be traced and additional tracing is recommended on heat sinks, such as fixings/supports. Heat sinks should be thermally isolated. Because the surface area of the conical outlet is often much smaller than the rest of the vessel, it may be necessary to extend the tracing beyond the conical area in order to fully compensate for the heat loss.

THERMAL DESIGN USING HEATING CABLES

Determine the heating cable families compatible with your tank application

To select a heating cable that is compatible with your application, familiarize yourself with the selection process for pipes as outlined in Section 1, Self-Regulating Cables design guide (H56882) and Section 2, Power-Limiting Cables design guide (H56883). Considering factors such as exposure temperature, maintain temperature, wall material, hazardous location requirements, etc., list all heating cable families that would be compatible with your tank application — e.g., BTV, QTVR, XTVR, HTV, VPL. The power outputs for the different heating cables are found in the Self-Regulating Cables and Power-Limiting Cables design guides.

Select the heating cable with the lowest maximum exposure temperature

Use the heating cable with the lowest possible maximum exposure temperature. Within each heating cable family, start with the cable that has the highest power output.

Example: Heating cable selection

Tank 1

Maintenance temperature 100°F maintain (from Step 1)
 Heat loss 458 W (from Step 2)

Recommended cable nVent RAYCHEM 10BTV2-CR

Adjust for aluminum tape attachment

For optimal heat transfer, the heating cable must be fixed to the tank wall (both metal and plastic) with aluminum tape. For self-regulating cables on metal tanks, this leads to an increase in the power output; on plastic tanks, the much lower thermal conductivity of plastic requires a de-rating of the power output of the cables. Table 2 below provides approximate adjustment factors for the power.

TABLE 2 APPROXIMATE POWER OUTPUT CHANGE FOR HEATING CABLES ATTACHED WITH ALUMINUM TAPE AT-180

Heating cable	Adjustment factor on metal tanks	Adjustment factor on polypropylene tanks	Adjustment factor on fiber-reinforced plastic tanks
BTV	1.20	0.70	0.80
QTVR	1.20	N/R	N/R
XTVR/HTV	1.15	N/R	N/R
VPL	1	N/R	N/R

N/R Not recommended due to temperature limitations of tank wall.

Multiply the power output at the maintain temperature (P_{heater}) by the appropriate adjustment factor f_{adj} from Table 2 above.

Formula: $P_{adj} = P_{heater} \times f_{adj}$

Example: Calculating the adjusted power of the heating cable (P_{adj})

Input P_{heater} = 3.7 W/ft (10BTV2-CR power output at 100°F)

Input f_{adj} = 1.20 (from Table 2)

Calculation P_{adj} = 3.7 W/ft x 1.20

P_{adj} = 4.4 W/ft for 10BTV2-CR at 100°F

Divide the total heat loss (Q_{total}) by the adjusted power of the heating cable (P_{adj}) at the desired maintain temperature to obtain the minimum required length (L_{heater}).

$$\text{Formula } L_{\text{heater}} = \frac{Q_{\text{total}} \text{ (W)}}{P_{\text{adj}} \text{ (W/ft)}} \text{ (round up)}$$

Example: Calculating the minimum required cable length (L_{heater})

Input $Q_{\text{total}} = 458 \text{ W}$ (from Step 2)

Input $P_{\text{adj}} = 4.4 \text{ W/ft}$ (from previous calculation)

$$\text{Calculation } L_{\text{heater}} = \frac{458 \text{ W}}{4.4 \text{ W/ft}} \text{ (round up)}$$

$L_{\text{heater}} = 104 \text{ ft}$ (rounded up)

Next, determine how to distribute cable over the surface you wish to trace. An average spacing of the heating cable (T_{average}) can be calculated by dividing the traced surface (S_{traced}) by the total length of the heating cable (L_{heater}).

$$\text{Formula } T_{\text{average}} = \frac{S_{\text{traced}} \text{ (ft}^2\text{)}}{L_{\text{heater}} \text{ (ft)}} \text{ (round up)}$$

Example: Determining cable distribution

For our vertical cylinder tank (3 ft diameter, 6 ft high), tracing the lower one-third of the wall of the tank:

Input $S_{\text{traced}} = 3 \text{ ft} \times 3.14 \times 2 \text{ ft}$ (as determined in Step 4a)

Input $L_{\text{heater}} = 104 \text{ ft}$ (from previous calculation)

$$T_{\text{average}} \text{ (ft)} = \frac{(3 \text{ ft} \times 3.14 \times 2 \text{ ft})}{104 \text{ ft}} = \frac{(18.8 \text{ sq ft})}{104 \text{ ft}} = 0.18 \text{ ft (2.2 in)}$$

In this case, the result is close to the minimum spacing interval, so some of the tracing may be placed on the bottom of the tank. The spacing should be reduced locally to bring more power to areas that require more heat, such as supports and fixings. The maximum spacing should typically not be more than 12 inches (~300 mm). Do not space adjacent heating cable closer than two inches (50 mm), because interaction will occur and power output will decrease.

By changing the heating cable and the spacing in the calculation, you can obtain the solution that best fits the specific requirements of your tank application.

WARNING: Fire hazard

There is a danger of fire from sustained electrical arcing if the heating cable is damaged or improperly installed. To comply with nVent requirements, certifications, and national electrical codes, and to protect against the risk of fire, ground-fault equipment protection must be used on each heating cable circuit. Arcing may not be stopped by conventional circuit breakers.

ELECTRICAL DESIGN OF HEATING CABLE

Determine maximum allowable circuit length

To determine the maximum allowable circuit length of your heating cable, refer to the data sheet in the Technical Data section on the nVent web site for that heating cable. For metal tanks, however, the maximum circuit length needs to be reduced by the appropriate factor shown in Table 3 because of the use of the aluminum tape and the increased power. For plastic tanks, the maximum circuit length need not be adjusted.

Adjust for aluminum tape

TABLE 3 APPROXIMATE ADJUSTMENT FACTORS FOR MAXIMUM CIRCUIT LENGTH OF SELF-REGULATING HEATING CABLES ON METAL SURFACES ATTACHED WITH AT-180 ALUMINUM TAPE

Heating cable	Circuit length adjustment factor on metal tanks
BTV	0.8
QTVR	0.8
XTVR/HTV	0.83

Simply multiply the allowed footage shown on the heating cable data sheet in the Technical Data section on the web site by this factor to determine the footage that can be installed on a given breaker size.

CONNECTION KIT SELECTION FOR SELF-REGULATING AND POWER-LIMITING CABLES

Now that you have determined your heating cable type and length, use the following chart to select the proper connection kits.

Note: nVent offers a full range of connection kits for power connections, splices, and end seals. These connection kits must be used to ensure proper functioning of the product and compliance with warranty, code, and approvals requirements.

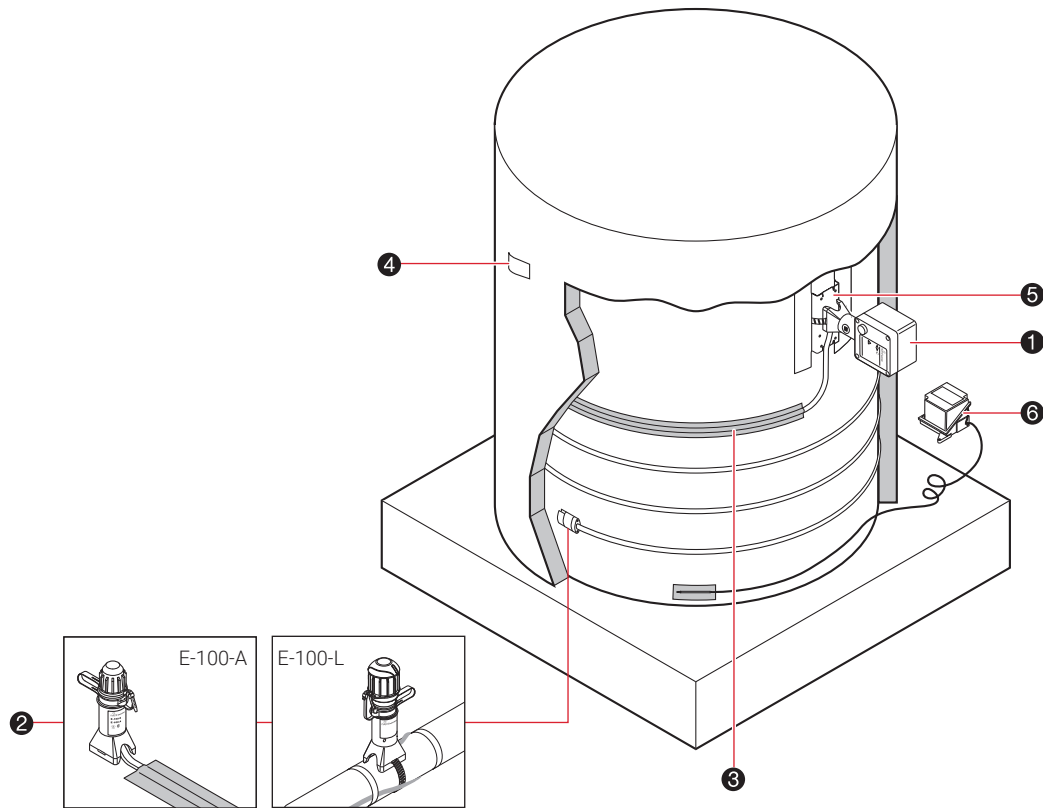


Fig. 6 Tank-tracing system connection kits and accessories

⚠ WARNING: Fire hazard

To prevent fire or shock, nVent RAYCHEM brand specified connection kits must be used. Do not substitute parts or use vinyl electrical tape.

TABLE 4 CONNECTION KIT AND ACCESSORY SELECTION FOR SELF-REGULATING AND POWER-LIMITING CABLES

Description	Catalog number
Connection kits	
1. Power connection kit (not shown)	JBS-100-A
Power connection kit with light	JBS-100-L-A
Splice connection (not shown)	S-150 (not for use with VPL and HTV)
2. End seal	
Below insulation	E-150 (not for use with VPL and HTV)
Above insulation	E-100-A
Above insulation, with light	E-100-L-A (100-277 V)
Accessories	
3. Aluminum tape	AT-180
4. Labels	ETL
5. Support bracket	SB-100-T
Controls	
6. Thermostat (see Control and Monitoring design guide (H56889))	

Tank Tracing
1. Gather information
2. Calculate tank heat loss
3. Choose heating technology
4. Product selection
5. Select thermostatic control

Step 4b Product selection for mineral insulated heating cables

For MI product selection and design, refer to Mineral Insulated Heating Cables design guide (H56884) or contact your nVent representative.

Tank Tracing
1. Gather information
2. Calculate tank heat loss
3. Choose heating technology
4. Product selection
5. Select thermostatic control

Step 5. Select the thermostatic control

There are two kinds of sensors for indicating temperature: "in-fluid" and "on-surface."

The "in-fluid" approach typically uses a thermowell protruding through the tank wall and into the fluid. Control of the heater is achieved by using a solid-state control device that receives its input from an RTD inside the thermowell.

The "on-surface" approach uses RTDs or bulb and capillary thermostats to control tank heaters by sensing temperatures on the outside surface of the tank wall. Sensors should be located midway between heating cables or heating pads. If your application has high heat-loss supports or accessories, place the primary sensor midway between the heating pad or cable and the support or accessory. The primary temperature sensor should be placed horizontally on the tank, refer to "Fig. 7".

For more details regarding the many options in control devices see Control and Monitoring design guide (H56889).

The Tank Tracing Design and Product Selection section presented a general approach to selecting a heat-tracing system for a tank or vessel. The tank heat loss can be calculated by using the graphs and equations on the following pages. The approach for the calculation is based on those in the TraceCalc Pro design software.

The overall heat loss (Q_T) of an insulated tank can be expressed as:

$$Q_T = Q_V + Q_S + Q_A$$

where:

Q_V = Heat loss through the insulated body of the tank

Q_S = Heat loss through the tank support mechanism (slab, legs, saddle, or other base support)

Q_A = Heat loss through accessories such as manholes, handholds, ladders, or handrails

To calculate the tank's overall heat loss (Q_T), follow these six steps:

1. Calculate the surface area of the tank.
2. Calculate the Q_V (heat loss through the insulated body of the tank).
3. Calculate the Q_S (heat loss through the base support).
4. Calculate the Q_A (heat loss through the accessories).
5. Calculate the Q_T (overall heat loss).
6. Calculate the final-design heat loss.

The heat-loss rates for insulated tank bodies (see "Table 6" and "Graph 1") are based on the following IEEE 515 provisions:

- Fiberglass insulation
- Tank located outdoors
- No insulating airspace between the tank surface and insulation

The tank body heat loss rates in Table 6 and Graph 1 assume a tank that is completely full and insulated with a minimum of one inch of fiberglass. However, Table 7 provides factors for adjusting the tank body heat loss for insulations other than fiberglass.

Tank Heat Loss Calculation
1. Calculate surface area of tank
2. Calculate Q_V
3. Calculate Q_S
4. Calculate Q_A
5. Calculate Q_T
6. Calculate final design heat loss

Step 1. Calculate the surface area of the tank

Cylinder Surface Area

The surface area of the cylindrical tank is equal to the area of the body (A_{body}) plus the area of both ends of the tank (A_{end}), or, in the case of a vertical cylinder resting on a slab, the area of the tank body (A_{body}) plus the area of the top (A_{end}). If the tank is a vertical cylinder resting on a slab, do not add in the bottom area at this point.

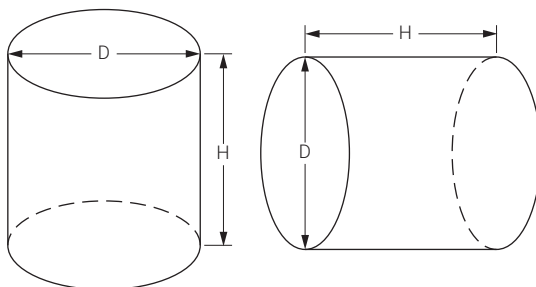


Fig. 7 Cylinder surface areas

To calculate the total surface area (A_v) of the tank cylinder:

- Calculate the surface area of the body:

$$(A_{body}) = \pi DH$$

- Calculate the surface area of one or both ends:

$$(A_{end}) = \pi D^2/4 \quad \text{or} \quad (A_{end}) = (\pi D^2/4) \times 2$$

- Add the results.

Table 5 below provides both the end and body areas of cylindrical tanks 6 to 20 feet in diameter and 8 to 25 feet high.

TABLE 5 CYLINDRICAL TANK SURFACE AREAS

D (ft)	Aend (ft²)	Abody (ft²)																	
		H (ft)																	
		8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25
6	29	151	170	189	208	227	245	264	283	302	321	340	359	378	396	415	434	453	471
7	39	176	198	220	242	264	286	308	330	352	374	396	418	440	462	484	506	528	550
8	51	202	227	252	277	302	327	352	377	403	427	452	478	503	528	553	579	604	629
9	64	227	255	283	311	340	368	396	425	453	481	509	538	566	594	622	650	679	707
10	79	252	283	315	346	377	409	440	472	503	535	565	597	629	660	692	723	754	786
11	95	277	311	346	381	415	450	484	519	553	588	622	657	692	726	761	795	830	864
12	114	302	340	377	415	453	491	528	566	604	641	679	717	754	792	830	868	905	943
13	133	327	368	409	450	491	531	572	613	654	695	736	776	817	858	899	940	981	1021
14	154	352	396	440	484	528	572	616	660	704	748	792	836	880	924	968	1012	1055	1100
15	177	377	425	472	519	566	613	660	707	754	802	849	896	943	990	1037	1084	1131	1179
16	202	403	453	503	553	604	654	704	754	805	855	905	955	1006	1056	1106	1157	1207	1257
17	227	427	481	535	588	641	695	748	802	855	908	962	1015	1069	1121	1175	1229	1282	1336
18	255	452	509	565	622	679	736	792	849	905	962	1018	1075	1131	1188	1244	1301	1357	1414
19	284	478	538	597	657	717	776	836	896	955	1015	1075	1135	1194	1254	1314	1373	1433	1493
20	315	503	566	629	692	754	817	880	943	1006	1069	1131	1194	1257	1320	1383	1446	1508	1571

Note: For the area of a horizontal tank, add the area of both ends.

TRUNCATED CONE SURFACE AREA

The total surface area (A_v) of a truncated cone tank (Fig. 8) is calculated as follows:

$$(A_v) = (A_{\text{body}}) + (A_{\text{top}}) + (A_{\text{bottom}})^*$$

* Do not include (A_{bottom}) if the bottom of the tank is resting on a slab.

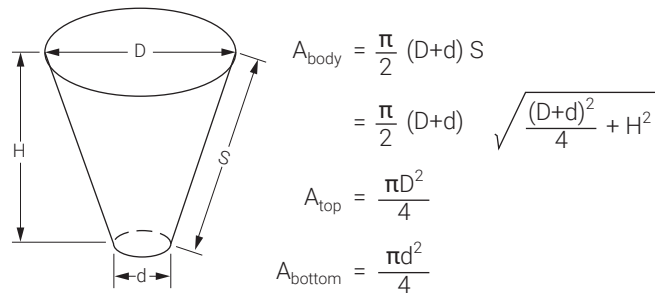


Fig. 8 Truncated cone surface areas

Tank Heat Loss Calculation
1. Calculate surface area of tank
2. Calculate Q_v
3. Calculate Q_s
4. Calculate Q_A
5. Calculate Q_T
6. Calculate final design heat loss

Step 2. Calculate the Q_v (heat loss through the insulated tank body)

PREPARATION

Calculating the Q_v requires the following tank information:

- Maintain temperature (T_M)
- Minimum ambient temperature (T_A)
- Insulation thickness

CALCULATION

Use the maintain and minimum ambient temperatures to arrive at the temperature differential. With the ΔT and the insulation thickness, calculate the Q_v :

Obtain ΔT by subtracting the minimum ambient temperature (T_A) from the maintain temperature (T_M):

$$\Delta T = (T_M) - (T_A)$$

Determine the heat loss rate (q_v) for the application. Table 6 shows the heat-loss rates (q_v) for typical temperature differentials and insulation thicknesses.


Determine the f insulation adjustment factor. Table 7 provides insulation factors for the most commonly used tank insulations.

Calculate the total heat loss through the tank body:

$$Q_v = A_v \times q_v \times f \text{ (insulation adjustment factor)}$$

TABLE 6 HEAT LOSS RATE (Q_v) PER SQUARE FOOT (WATTS/FT²)

ΔT °F (°C)	Insulation thickness				
	1" (25 mm)	1.5" (38 mm)	2" (51 mm)	3" (76 mm)	4" (102 mm)
50 (10)	3.4	2.3	1.7	1.2	0.9
100 (38)	7.1	4.8	3.6	2.4	1.8
150 (66)	11.0	7.5	5.6	3.7	2.8
200 (93)	15.3	10.3	7.7	5.2	3.9
250 (121)	20.0	13.5	10.2	6.8	5.1
300 (149)	24.9	16.8	12.7	8.5	6.5

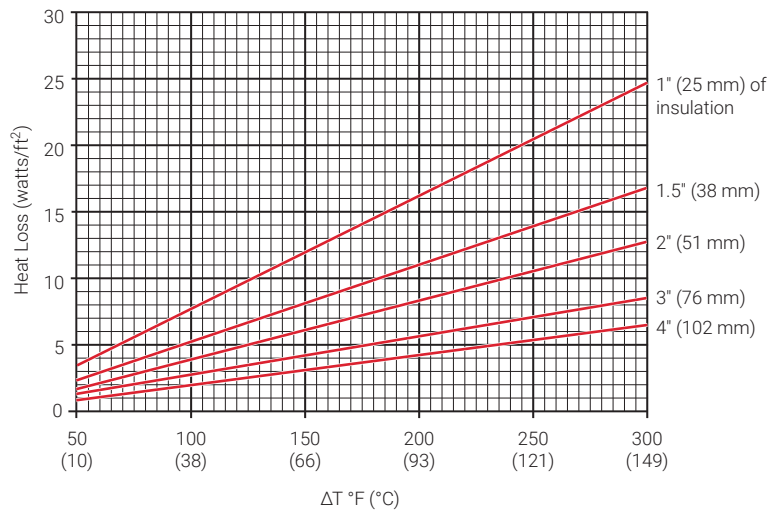

Graph 1 Heat loss rate per square foot (watts/ft²)

TABLE 7 INSULATION ADJUSTMENT FACTORS FOR TYPICAL INSULATIONS

Insulation types	Insulation adjustment factor	k factor*
Fiberglass	1.00	0.219
Cellular glass	1.36	0.298
Calcium silicate (Type 1)	1.76	0.386
Expanded perlite	2.13	0.466
Flexible elastomer	1.25	0.273
Mineral fiber blanket	1.64	0.360
Polyisocyanurate	0.87	0.19
Rigid polyurethane, W	0.87	0.19
Rigid polyurethane, spray	0.73	0.16
Rock wool/mineral wool	1.00	0.219

* Based on a 50°F (10°C) mean temperature with units Btu/hr-°F-ft²/in

Tank Heat Loss Calculation
1. Calculate surface area of tank
2. Calculate Q_V
3. Calculate Q_S
4. Calculate Q_A
5. Calculate Q_T
6. Calculate final design heat loss

Step 3. Calculate the Q_s (heat loss through the base support)

The following heat loss tables and accompanying graphs (Graph 2–Graph 5) provide typical base-support heat losses (Q_s) through the following types of base supports:


- Concrete slab or earth foundation
- Legs
- Concrete saddles
- Uninsulated skirt

CONCRETE SLAB OR EARTH FOUNDATION

Based on the ΔT and tank diameter, select the Q_s from Table 8 or Graph 2 below.

TABLE 8 HEAT LOSS (W) FOR A CONCRETE SLAB OR EARTH FOUNDATION

Tank diameter ft (m)	ΔT °F (°C)					
	50 (10)	100 (38)	150 (66)	200 (93)	250 (121)	300 (149)
5 (1.5)	137	278	451	566	711	857
10 (3)	283	573	864	1154	1452	1703
20 (6)	566	1163	1760	2325	2922	3488
30 (9)	848	1767	2616	3535	4383	5231
40 (12)	1131	2388	3518	4649	5906	7037
50 (15)	1374	2945	4320	5891	7265	8836

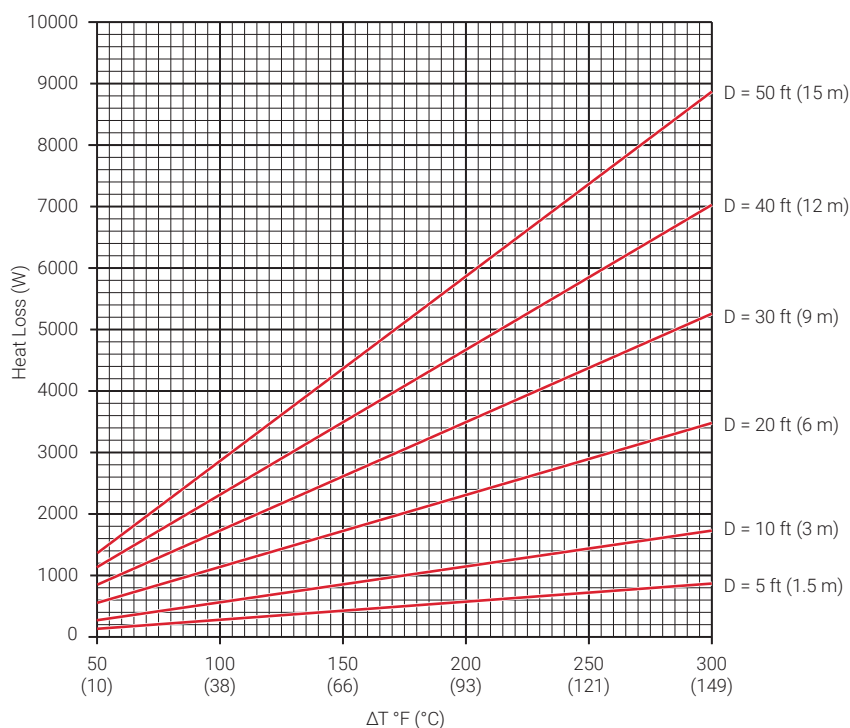

Graph 2 Heat loss (W) for a concrete slab or earth foundation


LEGS

Determine the heat loss for legs (Q_s) as follows:

- Based on the ΔT and tank diameter, select the heat loss from the Table 9 or Graph 3.
- Multiply the heat loss by the number of legs.

TABLE 9 HEAT LOSS (W) FOR A LEG SUPPORT

Tank diameter ft (m)	ΔT °F (°C)					
	50 (10)	100 (38)	150 (66)	200 (93)	250 (121)	300 (149)
5 (1.5)	26	52	77	103	129	155
10 (3) and above	85	169	351	336	420	505

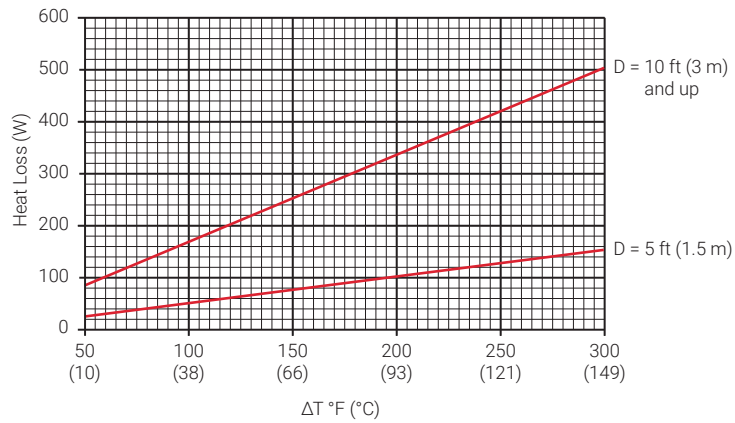

Graph 3 Heat loss (W) for leg support


CONCRETE SADDLES

Determine the heat loss for saddles (Qs) as follows:

- Based on the ΔT and tank diameter, select the heat loss (Qs) from Table 10 or Graph 4.
- Multiply the heat loss by the number of saddle supports.

TABLE 10 HEAT LOSS (W) FOR A CONCRETE SADDLE

Tank diameter ft (m)	ΔT °F (°C)					
	50 (10)	100 (38)	150 (66)	200 (93)	250 (121)	300 (149)
5 (1.5)	93	186	275	368	461	553
10 (3)	145	290	430	576	721	866
15 (4.6)	198	395	586	783	981	1179
20 (6)	250	500	741	991	1241	1491

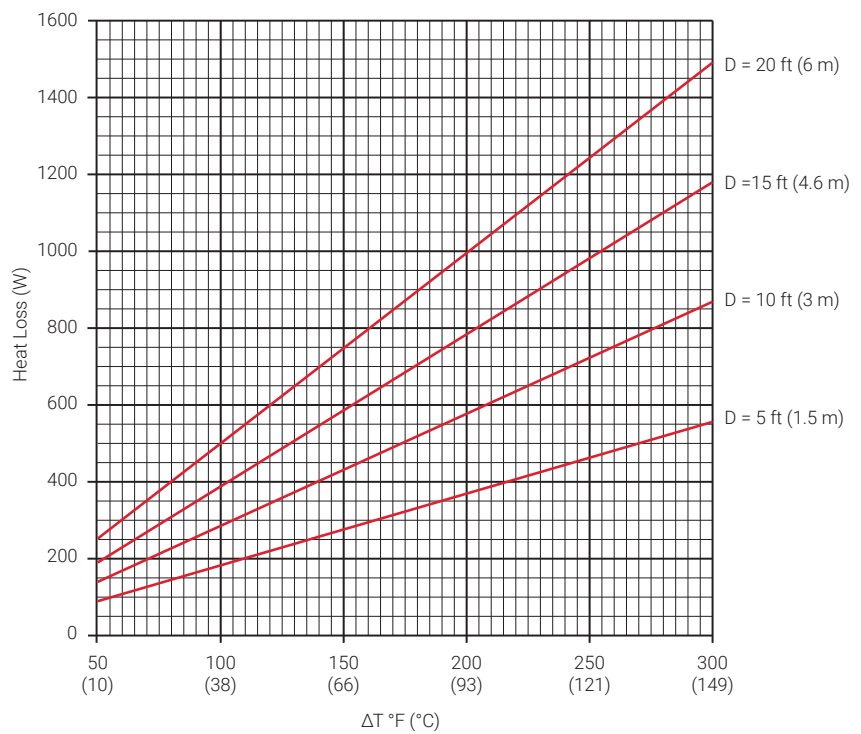


Graph 4 Heat loss (W) for a concrete saddle

UNINSULATED SKIRT

Based on the ΔT and tank diameter, select the Qs from Table 11 or Graph 5.

TABLE 11 HEAT LOSS (W) FOR AN UNINSULATED SKIRT

Tank diameter ft (m)	ΔT °F (°C)					
	50 (10)	100 (38)	150 (66)	200 (93)	250 (121)	300 (149)
5 (1.5)	402	805	1193	1595	1998	2400
10 (3)	806	1612	2389	3195	4000	4806
15 (4.6)	1209	2419	3585	4794	6003	7212
20 (6)	1613	3225	4780	6393	8006	9619

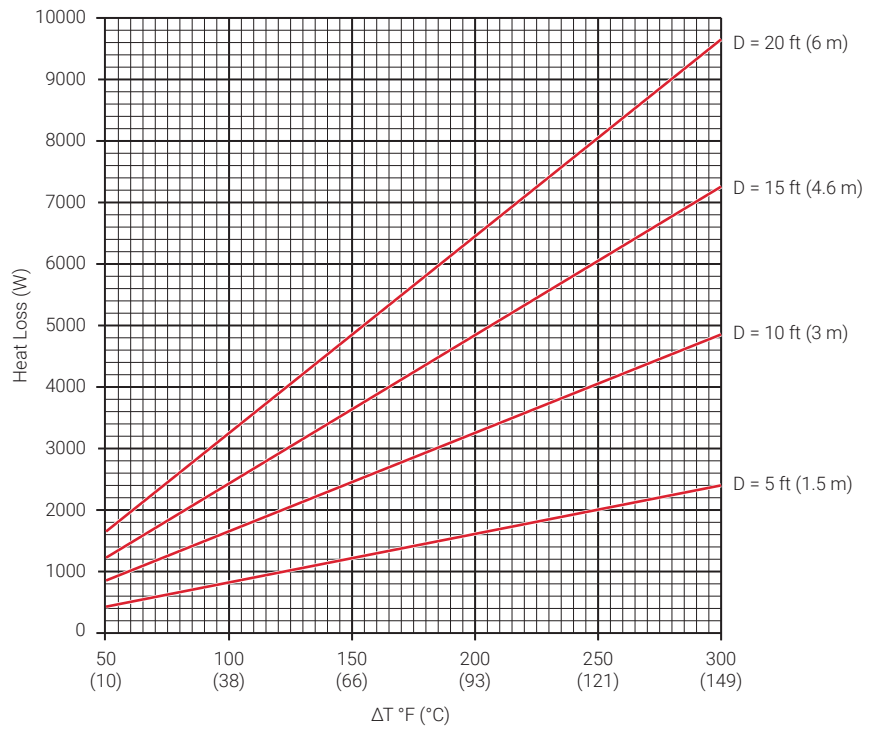

Graph 5 Heat loss (W) for an uninsulated skirt

Tank Heat Loss Calculation
1. Calculate surface area of tank
2. Calculate Q_V
3. Calculate Q_S
4. Calculate Q_A
5. Calculate Q_T
6. Calculate final design heat loss

Step 4. Calculate the Q_A (heat loss through the accessories)

The following heat loss tables and accompanying charts provide typical accessory heat losses (Q_S) through the following types of accessories:


- Manholes
- Handholes
- Ladders
- Handrails

MANHOLES

Select the heat loss for a manhole from Table 12 or Graph 6. The heat loss is based on a 2-foot diameter cover and a 1-foot tall base. The base and cover are uninsulated.

TABLE 12 HEAT LOSS (W) FOR A MANHOLE

	ΔT °F (°C)					
	50 (10)	100 (38)	150 (66)	200 (93)	250 (121)	300 (149)
Heat loss (W)	564	1120	1680	2237	2807	3401

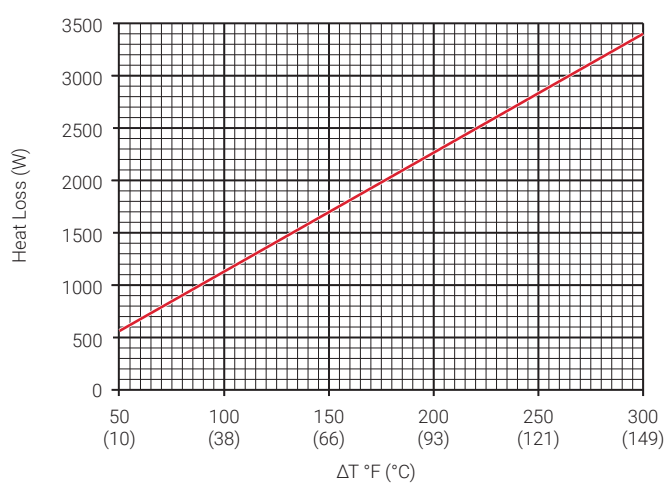

Graph 6 Heat loss (W) for a manhole


HANDHOLES

Calculate the heat loss for handholes as follows:

- Select the heat loss from Table 13 or Graph 7 based on the ΔT . Heat loss is based on a 0.5 foot diameter, uninsulated surface.
- Multiply the heat loss you select by the number of handholes.

TABLE 13 HEAT LOSS FOR A HANDHOLE

	ΔT °F (°C)					
	50 (10)	100 (38)	150 (66)	200 (93)	250 (121)	300 (149)
Heat loss (W)	90	178	265	351	437	526

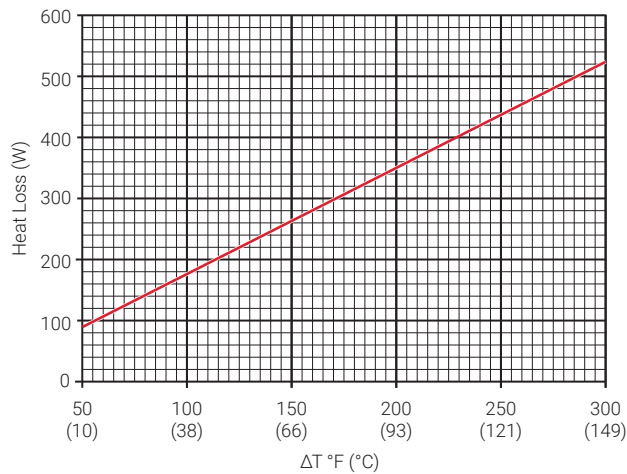

Graph 7 Heat loss (W) for a handhole

Tank Heat Loss Calculation
1. Calculate surface area of tank
2. Calculate Q_V
3. Calculate Q_S
4. Calculate Q_A
5. Calculate Q_T
6. Calculate final design heat loss

Step 5. Calculate the Q_T (overall heat loss)

Add the heat-loss rates (Q_V , Q_S , and Q_A) from Steps 2, 3, and 4.

Outdoor application:

$$Q_T = Q_V + Q_S + Q_A$$

Indoor application:

$$Q_T = 0.9 \times (Q_V + Q_S + Q_A)$$

Tank Heat Loss Calculation
1. Calculate surface area of tank
2. Calculate Q_V
3. Calculate Q_S
4. Calculate Q_A
5. Calculate Q_T
6. Calculate final design heat loss

Step 6. Calculate the final design heat loss

nVent recommends that the final design heat loss should include a 20 percent safety factor.

$$Q_F \text{ (Final design heat loss)} = Q_T \times 1.20$$

Note that this same heat-loss calculation approach should be used for insulated polypropylene and fiber-reinforced plastic (FRP) tanks.



North America

Tel +1.800.545.6258
Fax +1.800.527.5703
thermal.info@nVent.com

Latin America

Tel +1.713.868.4800
Fax +1.713.868.2333
thermal.info@nVent.com



Our powerful portfolio of brands:

CADDY ERICO HOFFMAN RAYCHEM SCHROFF TRACER